


AC-I

Wiring Diagram and Installation Notes

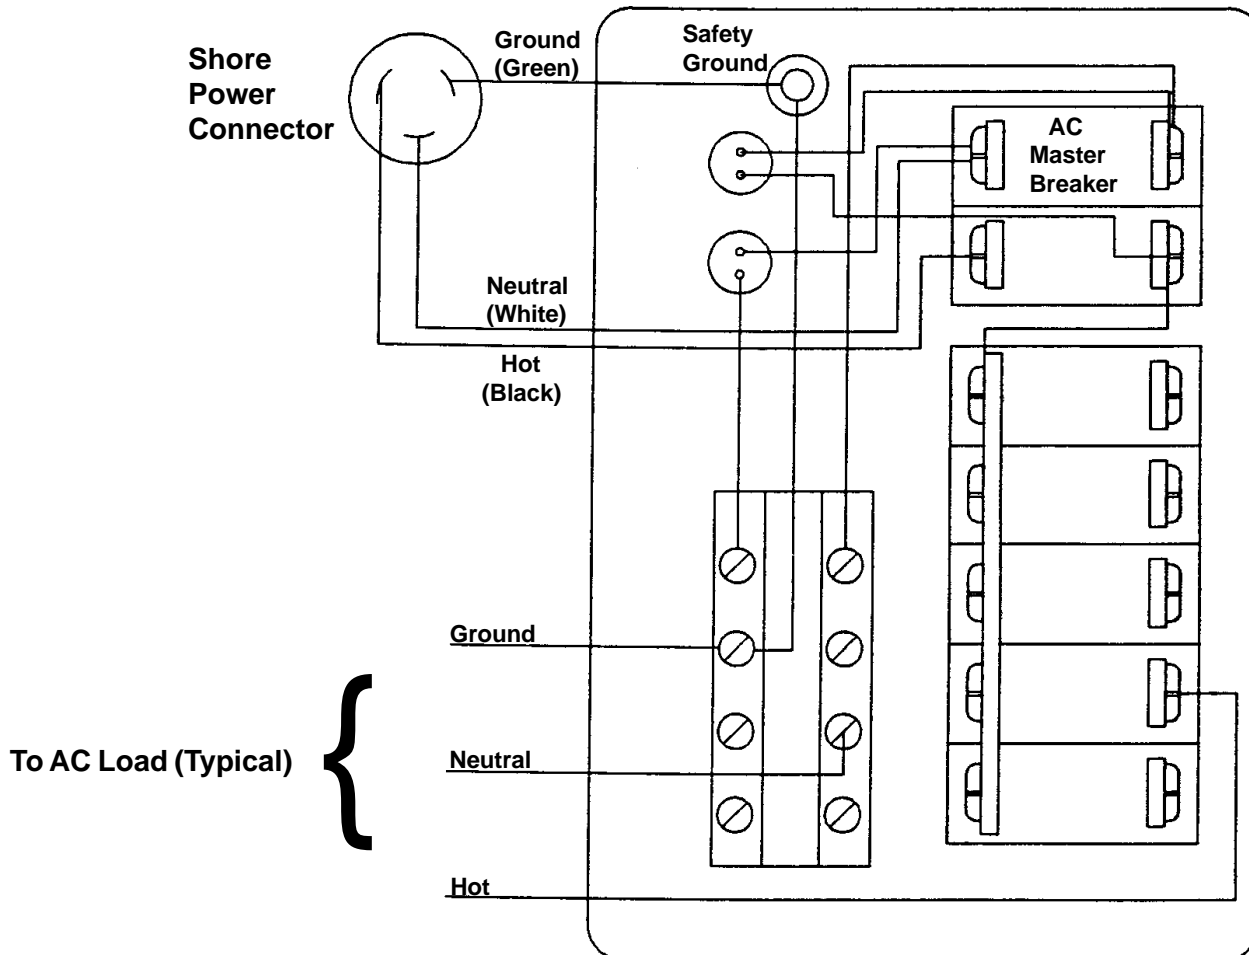

IMPORTANT INSTALLATION NOTES

1. 40 and 50 amp breakers are rated to a maximum of 120 VAC line-to-neutral or 240 VAC line-to-line. They are not rated for 240 VAC line-to-neutral systems.
2. The maximum current capacity of the installed bus bar is 50 amps. Also, a 50 amp double-pole master breaker must be installed if total loads at any given time may exceed 30 amps.
3. See the reverse of this sheet for important information regarding panel wiring to conform to USCG regulations and ABYC standards.

D02000035A
As of July 2001



U.S.A. HEADQUARTERS
P.O. Box 1306, Newport Beach, CA 92663
Phone: 714-751-0488 Fax: 714-957-1621
E-Mail: sales@newmarpower.com

ELECTRONIC POWER PRODUCTS
COMMUNICATION • NAVIGATION
www.newmarpower.com

EURO WAREHOUSE
Phone: +31-35-603-2494 Fax: +31-35-603-2149
E-Mail: sales@newmarpower.com